



Top View

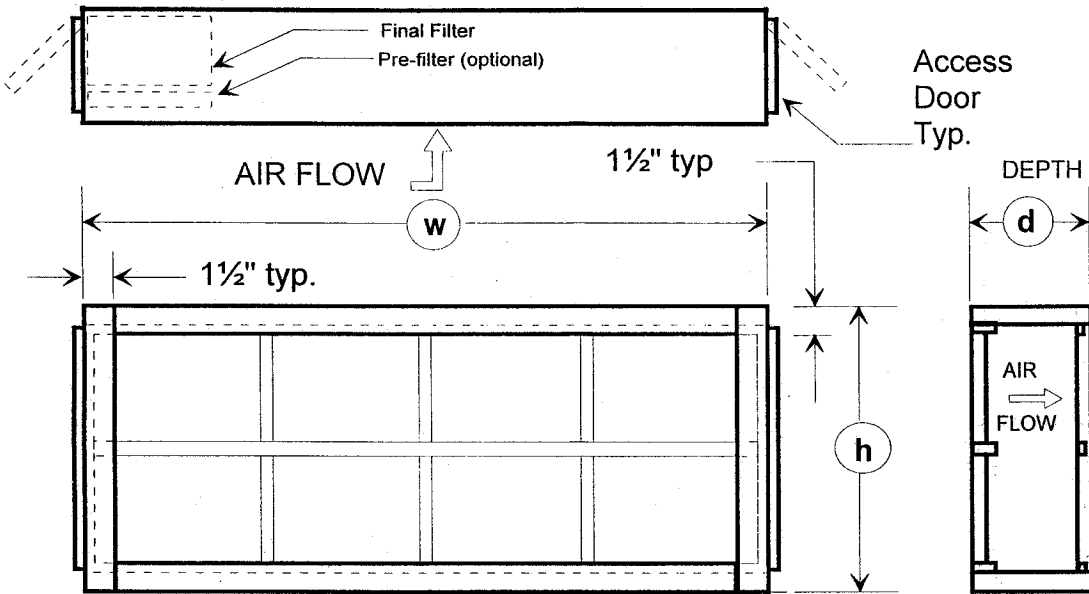

Filter Schedule				
Qty	Size	Model	Eff %	P.Drop

NOTES:

1. Housings are factory assembled and manufactured from 16 gauge welded galvanized steel
2. Filter tracks are made from anodized extruded aluminum
3. Housing Weight: _____ lbs. (less filter)
4. Housing Depth : 22" or _____ inches

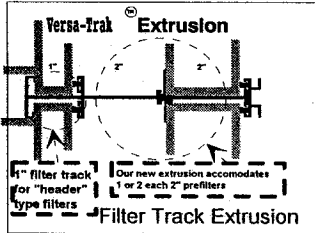

Front View

Side View

TAG: _____

Options:

- Stainless Steel body
- Insulated
- Aluminum body
- Painted
- Gage 200 __-AF

Width Code (# of filters)	1	1 1/2	2	2 1/2	3	3 1/2	4	4 1/2	5	5 1/2	6	6 1/2	7
Width Inches (W)	23 3/8	34 3/4	46 3/4	58 3/8	70 3/8	81 1/2	93 1/2	104 3/8	116 3/8	128 3/8	140 3/4	151 5/8	163 3/8

Standard ASHRAE Housing Code

Height Code	Height Inches (H)	1	1 1/2	2	2 1/2	3	3 1/2	4	4 1/2	5	5 1/2	6	6 1/2	7
1/2	15													
1	27													
1 1/2	39													
2	51													
2 1/2	63													
3	75													
3 1/2	87													
4	99													

Side Access Housing
SUBMITTAL

Model "A"

(408) 441-8000

Project: _____

HVAC Mech: _____